A0

| LEGENDA | |
|---|---|
| **FLUIDO** | **DESCRIZIONE** |
| FI-SPK | WATER MAIN FOR FIRE FIGHTING |
| – | FIRE HYDRANT UNIT0 (ABOVE GROUND) |
| – | CONCRETE INSPECTION PIT WITH ISOLATION VALVE |
| FW | FOUL WATER PIPE (SLOPE = 1%) |
| – | FOUL WATER CONCRETE INSPECTION PIT |
| SW | SURFACE WATER PIPE (SLOPE = 0.5%) |
| – | SURFACE WATER CONCRETE INSPECTION PIT |
| – | SURFACE WATER ROAD GULLY |
| – | SURFACE WATER CHANNEL DRAIN |
| WR | RAINWATER RECYCLING PIPE |
| W | POTABLE WATER PIPE |
| W-IRR | WATER IRRIGATION PIPE |
| WF | WATER PIPE FOR PLANT FIRE |

**NOTE**
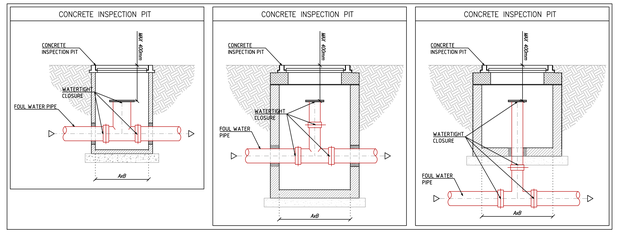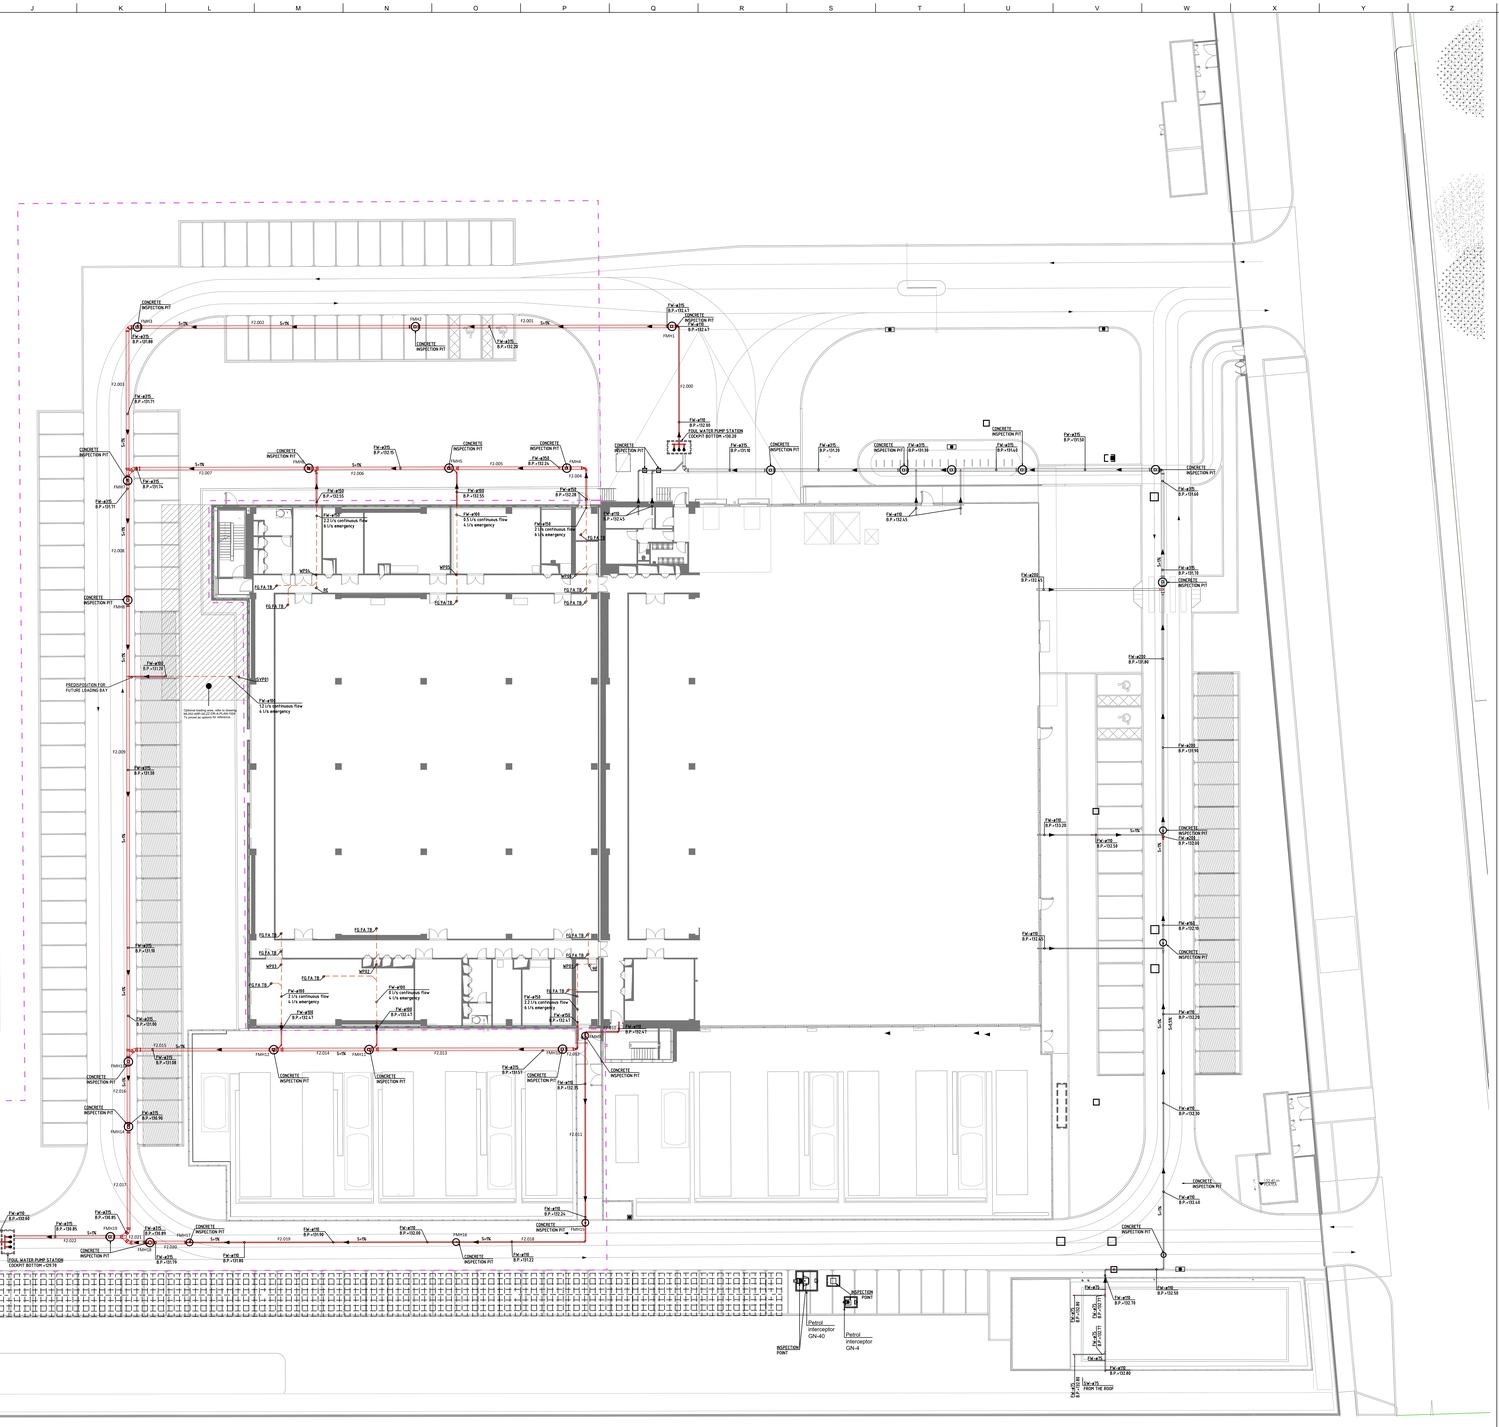
FOR COORDINATION MECHANICAL AND ELECTRICAL SYSTEM SEE DRAWING:
n° ML052-ARP-00-ZZ-DR-C-SANR-1002